

Hybrid Distributed Renewable Power (HDRP) Generation for Rural Area: Bangladesh Perspective

Md. Mahfuzur Rahman, Sourav Barua, and Mushfiqur Rahman

Abstract— Energy is one of the essential needs of human life. A good energy system adds value to the lives of people in a society. This energy generation involves both non-renewable and renewable energy sources. Among them renewable energy becoming more and more popular as it is a sustainable, and environmentally friendly source of energy. Moreover, it requires less maintenance than traditional generators. Like other developing countries energy is the most important factor in Bangladesh. Bangladesh is still struggling to solve the energy crisis of the large population. So it is essential to look for other sources which can compensate the deficiency of the existing power system. Already the use of different types of renewable sources like solar energy, bioenergy, wind energy, has come into focus of several government and non-government organization. In this paper we mainly focused on providing the need of energy of a typical rural village with a Hybrid Distributed Renewable Power (HDRP) system which includes solar energy and Biomass. A model of off-grid HDRP generation and distribution system is analysed in HOMER (Hybrid Optimization Model for Electric and Renewable) to find the optimal size and cost of different components of the system.

Index Terms— Hybrid Distributed Renewable Power (HDRP), Distributed Generation, Rural Area, Renewable Energy Resources, Solar Energy, Photovoltaic, Biomass.

1 INTRODUCTION

Bangladesh has enormous potentiality of renewable energy development. Since, power crisis has become a phenomena in Bangladesh, so searching for new resource of energy is a burning question at present. For economic solvency, upgrading the standard of living and industrialization, Power is an essential need of developing countries like Bangladesh. But in this twentieth century, still we have to depend on gas, coal, hydro power, fossil fuel plants which are insufficient for fulfilling the increasing power demand now as well as in the future and also a major barrier for foreign investment. Moreover, a huge portion of the total population of our country still does not have the access to electricity. Only 10% of the rural households have electricity connection where 70% of the total population live in rural areas. There are some parts of Bangladesh which will not get the access of electricity connection from the national grid within the next 30 years which will be an alarming situation. Besides, degradation of the capacities of existing power plants with derated machineries continuously causing load shedding problems in consumer and industrial distribution system. So, it's high time, to utilize renewable energy resources for off-grid, power generation and enlighten even the remote areas of Bangladesh. [1].

At present, 53% of the total electricity generation of Bangladesh is from the power plants under public sector and 47% of the net generation of the country are from the private sector. In contrast, of the power demand of 7500-

8000MW, the generation is only 5000-6000MW including quick rental plants. That's why; to increase the production of electricity, Government has imposed priority on renewable energy technology and aimed at target to produce 500MW of electricity from these resources by 2016 [1, 2].

Renewable energy is achieving immense popularity in developed and developing countries due to noiseless, pollution free and production of electricity without emitting poisonous gases. For the preservation of the Green environment from global warming and reducing the threats of the Greenhouse effect, renewable energy is the best alternative way for power generation. In Bangladesh, available renewable energy resources are solar energy, wind power, biofuels, biomass, geothermal, tidal energy and Micro hydro power plants. Among them, solar energy and biomass are two main resources for alternative power generation. Biofuels are an attractive source of energy as it reduces CO₂ emission and can be used instead of fossil fuels which is depleting at an alarming rate. Production of biodiesel from algae is less time consuming and cheaper than the petroleum diesel. Recycling industry wastes raises a total of 436t/d of material recovery. Moreover, 3,054t/d of wastes is expected to be collected in 2015 and cumulative disposal volume is estimated at about 9 million tonnes by the end of 2015. Production of Biogas from these huge amounts of waste materials can be used in gas turbine power stations to reduce pressure on reserving natural gases [1]. Solar energy is an inevitable alternative source of energy as Bangladesh has a geographical fitting condition for solar power that receives an average daily solar radiation of 4-6.5 kWh/m². As a result, photovoltaic system installation is becoming an integral part of renewable energy production in Bangladesh both in rural and city areas. [1, 3].

-
- Md. Mahfuzur Rahman, Bangladesh, E-mail: mm_rahman@outlook.com
 - Sourav Barua, Bangladesh, E-mail: pappu243@gmail.com
 - Mushfiqur Rahman, Bangladesh, Email: mushfiqbd91@gmail.com

There are several studies about deploying distributed renewable power generation system. For example, [4] highlights the benefits of distributed generation for developing countries and modelled a PV system and analysed the cost pertaining to that system for two different household scenario. In this paper, we highlighted the benefits of Hybrid Distributed Renewable Power (HDRP) generation which is a combination of two or more renewable energy sources. A HDRP system, including two renewable energy sources is also modelled to provide electricity to two typical villages of Bangladesh. In this work energy consumption scenario of two villages of Bangladesh are considered and an off grid HDRP system is modelled to provide the energy need of the two villages. The optimal sizes and costs of the components and the feasibility of the model is analysed using The Hybrid Optimization Model for Electric Renewable (HOMER) software.

The rest of the paper is arranged as follows: In section II, A brief discussion about HDRP and its benefits are given. Section III includes the simulations and results. And finally section IV provides the conclusion of this paper.

2 HYBRID DISTRIBUTED RENEWABLE POWER (HDRP)

Distributed Generation is an efficient system in the world of the power system. It is now being used all over the world for small scale power generation for household applications as an off-grid or grid connected system. This type of system are located near or at the point of use. Distributed generation technologies include small wind, small hydro, solar photovoltaic (PV), biomass, micro turbines, gas turbines, fuel cells etc. Hybrid Distributed Renewable Power (HDRP) system combines two or more renewable energy sources, that when integrated, overcome the limitations inherent in either. To achieve higher reliability, redundant energy sources are used in HDRP, which can simultaneously improve the quality and availability of the power. This type of system can be designed to maximize the use of renewable energy, resulting in a lower emission than the traditional fossil fuelled power sources. HDRP system can be designed to acquire desirable attribute at the lowest acceptable cost, which will be the key to market acceptance. This type of power system can be used for village power, remote (off-grid) power etc.

HDRP systems can be deployed largely to provide the electricity deprived villages of Bangladesh. Two main renewable energy sources in Bangladesh are solar energy and biomass energy. In villages, we can provide a biogas generator where we can use biodiesel as a fuel rather than fossil fuels. Production of biodiesel is available from algae, coconut, Jatropha, rapeseed, peanut, sun-flower and soya bean. Solar energy can be utilized through photovoltaic systems which is enough for a single home, school or a local market. In this paper, we modelled an off-grid HDRP system using this two renewable energy sources to provide the electricity needed for daily activities of two typical villages of Bangladesh.

3 SIMULATION AND RESULTS

3.1 Simulation Tool

In this paper all the simulations are carried out on the Hybrid Optimization Model for Electric Renewable (HOMER) version 2.68. HOMER facilitates the task of evaluating design of both off-grid and grid connected power system for a variety of applications. If the model with inputs, component costs and, resource availability is provided, HOMER can generate results that provide a feasible configurations sorted by net present cost.

3.2 Load profile of the villages

In this paper, we have assumed two typical villages in Bangladesh and the daily loads of the two villages are considered for the simulation. In the first village the electrical appliances are distributed among 900 houses, 2 primary schools, 1 high school, 1 post office, 2 poultry farms, a market with 25 shops and 4 irrigation pumps. The second village includes 700 houses, 2 primary schools, 1 high school, 1 post office, 1 poultry firm, 1 dairy firm, a market with 200 shops, 1 bus stoppage, 1 community clinics and 3 irrigation pumps. The primary load for village 1 is 3.1 MWh/d and 394 kW peak and for village 2 the primary load is 2.4 MWh/d and 368 kW peak. The loads are assumed as ceiling fans, lights, water pump, television etc.

3.3 Solar irradiance

The solar irradiance of Bangladesh is obtained by HOMER software via internet. The scaled annual average radiation of the site is obtained as 4.72kWh/m² per day.

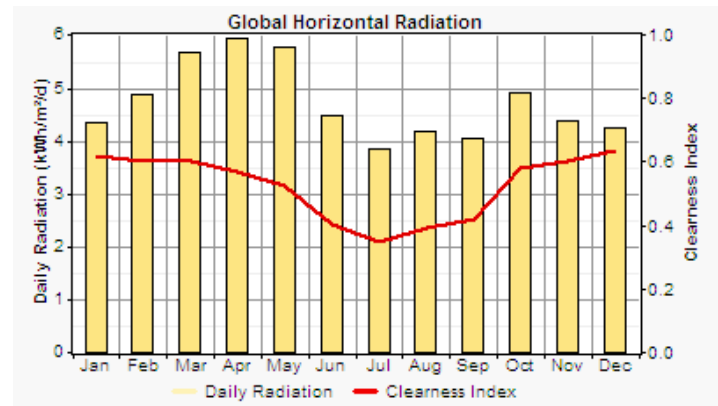


Fig 1 shows the solar irradiance on the site over the year.

3.4 Biomass

The scaled annual average biomass resources is presumed to be 50.6 tonnes/day, which includes carbon content of 5%, Gasification ratio 0.7 kg/kg and Lower Heating Value of biogas is taken as 5.5 MJ/Kg. Fig 2 shows the available biomass resources. The capital, replacement and O and M cost for 20kW biomass source is taken as \$17000, \$1700 and \$0.5/hr. And the considered sizes are 0kW, 50kW, 100kW, 120kW, 150kW, 200kW and 250kW.

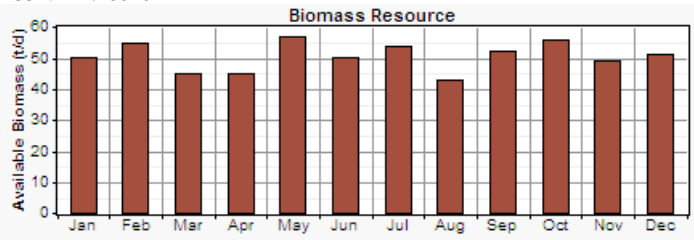


Fig 2: Available Biomass resources

3.5 Size of the Photovoltaic

Size of photovoltaic is very crucial part of the modelled system. An under-sized PV system will not perform accurately to charge the battery and supply the load. The cost per Watt-peak of PV may vary from \$1.5 to \$2 [5]. In this paper the installation, replacement and maintenance (O and M) costs for 1kW-p solar power generator are taken as \$2500, \$2500 and \$0 respectively [4]. The considered size of the PV panel in this simulation are 100kW-p, 200kW-p, 300kW-p, 400kW-p, 500kW-p and 600kW-p. Other properties are, lifetime 20 years, derating factor 80%, slope 23.5 degrees, and ground reflectance 20%. No tracking system is considered in the simulation.

3.6 Battery

The vision 6FM200D battery is selected in HOMER. The properties of the battery are: Nominal voltage 12V, nominal capacity 200Ah (72.4kWh), lifetime throughput 917kWh, 20 batteries per string, minimum battery life is 4years and installation, replacement and O&M costs are \$275, \$275 and \$20/year [4].

3.7 Inverter

For a 1 kW inverter the capital, replacement and O and M cost is considered as \$250, \$250 and \$100/yr respectively [4]. In this is paper the sizes of inverters are considered as 50 kW, 100 kW, 150 kW, 200 kW, 250 kW and 300 kW. The lifetime of the inverter is taken as 15 years and efficiency is assumed 90%.

3.8 Modelling of the systems in HOMER

The systems are modelled in HOMER by selecting “do not model grid” option, which represents a typical stand-alone system. The model for village 1 and village 2 are shown in Fig 3 and Fig 4 respectively.

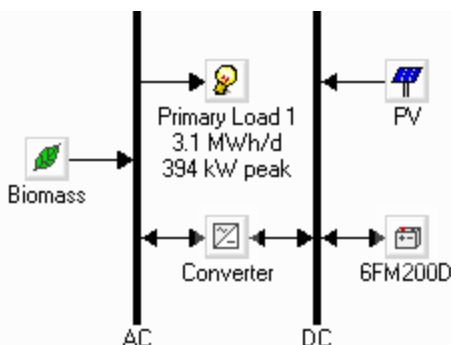


Fig 3: Model of Village 1 in HOMER

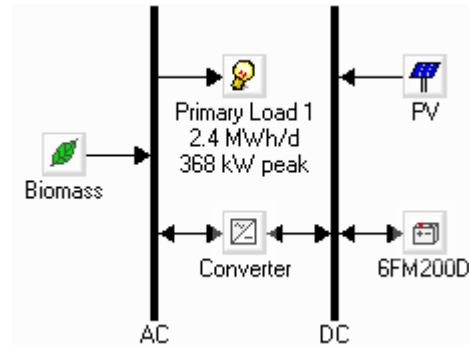


Fig 4: Model of Village 2 in HOMER

3.9 Simulation result

By simulating all the data HOMER generates an optimal result for the HDRP system for the two villages. It finds the best sizes of photovoltaic panel, biomass, inverter, and battery based on the lower Net Present Cost (NPC). Fig 5 and Fig 6 show the search area space in HOMER where the optimized sizes are highlighted with yellow mark. The optimal sizes for village 1 is founded as 500kW photovoltaic panel, 120kW Biomass plant, 3units of battery and 200kW inverter and for village 2 the optimized sizes are 200kW Photovoltaic panel, 100kW biomass plant, 1 unit of battery, and 100kW converter. The initial cost found by HOMER is \$1,418,500 and \$615,500 for village 1 and 2 respectively. The total operating costs are \$70,534/yr and \$43,443/yr respectively.

	PV Array (kW)	Bio (kW)	6FM200D (Strings)	Converter (kW)
1	100.000	50.00	1	50.00
2	200.000	100.00	2	100.00
3	300.000	120.00	3	150.00
4	400.000	150.00	4	200.00
5	500.000	200.00	5	250.00
6	600.000	250.00	6	300.00
7				
8				
9				
10				

<< Hide Winning Sizes Overall winner Category winner

	PV Array (kW)	Bio (kW)	6FM200D (Strings)	Converter (kW)
1	100	50	1	50
2	200	100	2	100
3	300	120	3	150
4	400	150	4	200
5	500	200	5	250
6	600	250	6	300

Fig 5: Optimized sizes of components for village 1

The total Net Present Costs (NPCs) are \$2,320,159 and \$1,179,851. And the Cost of Energy (COE) found for two villages are \$0.197/kWh and \$0.124/kWh respectively.

	PV Array (kW)	Bio (kW)	6FM200D (Strings)	Converter (kW)
1	100.000	50.00	1	50.00
2	200.000	100.00	2	100.00
3	300.000	120.00	3	150.00
4	400.000	150.00	4	200.00
5	500.000	200.00	5	250.00
6	600.000	250.00	6	300.00
7				
8				
9				
10				

<< Hide Winning Sizes Overall winner Category winner

	PV Array (kW)	Bio (kW)	6FM200D (Strings)	Converter (kW)
1	100	50	1	50
2	200	100	2	100
3	300	120	3	150
4	400	150	4	200
5	500	200	5	250
6	600	250	6	300

Fig 6: Optimized sizes of the components for village 2

Fig 7 and Fig 8 show all the optimize results found by HOMER for village 1 and village 2 respectively. Table I and III show the net production from different sources for village 1 and 2. And Table II and IV show the total consumptions by the two villages. Fig 9 and 10 show the cash flow summery by components and by cost type respectively.

	PV (kW)	Bio (kW)	6FM200D (kW)	Conv. (kW)	Initial Capital	Operating Cost (\$/yr)	Total NPC	COE (\$/kWh)
	500	120	60	200	\$ 1,418,500	70,534	\$ 2,320,159	0.197

Fig 7: Optimization results for village 1

	PV (kW)	Bio (kW)	6FM200D (kW)	Conv. (kW)	Initial Capital	Operating Cost (\$/yr)	Total NPC	COE (\$/kWh)
	200	100	20	100	\$ 615,500	43,443	\$ 1,170,851	0.124

Fig 8: Optimization results for Village 2

From the cash flow summery for Fig 9 and 10, we can see the capital cost for PV is maximum. On the other hand, the operating cost of biomass is maximum. The fuel cost for the system is zero.

From Table I, The PV array selected for village 1 can produce 748,414kWh/yr which is 57% of the total production. And another 43% produced from the Biomass.

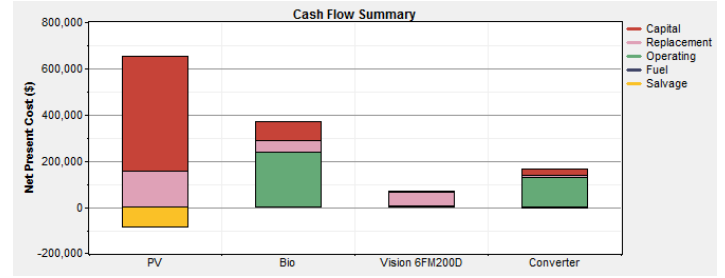


Fig 9: Cash flow summary by components

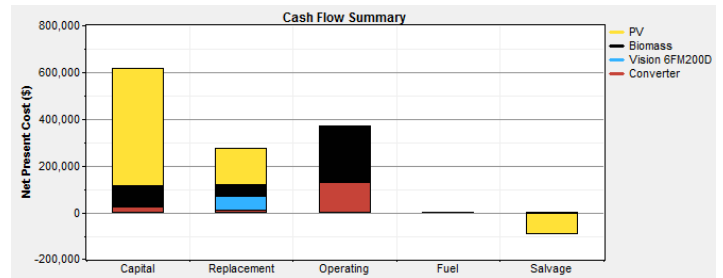


Fig 10: Cash flow summary by cost types

Table I
 Production from Different Sources for Village 1

Production	KWh/yr	%
PV array	748,414	57
Biomass	572,152	43
Total	1,320,566	100

Table II
 Energy Consumption of Village 1

Consumption	KWh/yr	%
AC primary load	919,478	100
Total	919,478	100

On the other hand, from Table III, energy produced for Village 2 is 299,366kWh/yr by the PV array which is 35% of the total production. And energy production from biomass is 567,108kWh/yr which is 65% of the total production.

Table III
 Production from Different Sources for Village 2

Production	KWh/yr	%
PV array	299,366	35
Biomass	567,108	65
Total	866,474	100

Similarly, it is possible to include other sources (e.g. Wind power) and find the optimal size and usage of the source using HOMER.

Table IV
Energy Consumption of Village 2

Consumption	KWh/yr	%
AC primary load	741,502	100
Total	741,502	100

Table II and Table IV show the total energy consumption for village 1 and village 2 respectively.

3.10 Result Analysis

The current per unit cost of Electricity in Bangladesh varies from \$0.01 to \$0.08 for government owned power plants. For gas based power plant, per unit cost varies between \$0.06 to \$0.07 for the Quick Rental Power Plants (QRPPs) and \$0.02 to \$0.05 for the Independent Power Producers (IPPs). And in case of furnace oil fuelled power plant, per unit cost is about \$0.2 for QRPPs and varies from \$0.21 to 0.22 for IPPs [6]. For HDRP system, per unit costs are found \$0.197 and \$0.124, which is quite better than the furnace oil fuelled power plants. So, it is feasible to use this HDRP system. But there are many other issues involved while taking a decision between HDRP system and other power plants. There are many advantages and disadvantages HDRP system like, sustainability, lower emission, usage of renewable fuel, low operating cost, requirement of large area, cannot be used to generate power to satisfy major part of demand, large capital cost, low efficiency etc. So, it may not be possible to replace the furnace oil fuelled power plant by HDRP system. But HDRP system can assist the existing sources in a considerable manner by deploying it for the remote areas where the electricity is still out of reach.

4 CONCLUSIONS

In this paper, the feasibility of deploying HDRP system is experimented in HOMER by using it for providing the electricity need of two typical villages of Bangladesh. It is found that HDRP is feasible but, not for supplying major demand. But this system can considerably assist the existing system. Future studies may include, synchronizing the system with existing grid and finding the stability of the existing power system with large integration of HDRP systems.

REFERENCES

- [1] K. Anam, H. A. Bustam, "Power Crisis & Its Solution Through Renewable Energy in Bangladesh," in *Multidisciplinary Journal in Science and Technology*, September edition, 2011.
- [2] "Development of Renewable Energy Technology by BPDB" available at <http://www.bpdb.gov.bd>.
- [3] M. S. Islam, A. M. H. R. Khan, S. Nasreen, F. Rabbi, and M. R. Islam, "Renewable Energy: The Key to Achieving Sustainable Development of Rural Bangladesh," in *Journal of Chemical Engineering, IEB*, Vol. ChE.26, No. 1, December 2011.
- [4] D. O. Akinyele, R. K. Rayudu, "Distributed Photovoltaic Power Generation for Energy Poor Households: The Nigerian Perspective," in *The IEEE PES Asia-Pacific Power Energy Engineering Conference 2013, Hong Kong*, pp: 1-6, 8-11 December 2013.

- [5] M. Hassan and F. Khan, "A comparative study on installation of solar PV system for grid and non-grid rural areas of Bangladesh," in Proc. 2012 Developments in Renewable Energy Technology Conf.
- [6] Mustafa, K. Mujeri, Tahreen Tahrima Chowdhury, "Quick Rental Power Plants in Bangladesh: An Economic Appraisal," Bangladesh Institute of Development Studies, June 2013.

AUTHORS

Md. Mahfuzur Rahman completed his B.Sc in Electrical and Electronic Engineering from American International University-Bangladesh in 2014. Currently he is pursuing his M.Sc in Electrical and Electronic Engineering at American International University-Bangladesh. His research interest includes power system stability and control, renewable energy technologies, electric vehicle, wireless communication etc.



Mr. Sourav Barua has completed B.Sc in Electrical and Electronic Engineering from American International University-Bangladesh in 2014. His research interest includes, plug-in hybrid vehicle (PHEV), distributed power generation, smart grid, electrical power system, industrial drives and control system etc.



Mr. Mushfiqur Rahman completed his B.Sc in Electrical and Electronic Engineering from American International University-Bangladesh in 2014. He is currently pursuing his MS in Renewable Energy Technology from Institute of Energy, University of Dhaka. His research interest includes renewable energy technologies, electrical power system etc.

