

# Wind Turbine System with Doubly-Fed Induction Generator and Rotor Power Feedback Control

Hasan Mansouri, Mahdiyeh Eslami, Abolfazl Jabbari, Mehرداد Nazari

## Abstract:

The paper deals with a variable speed wind turbine fitted with a DFIG (Doubly-Fed Induction Generator) vector control system. A new rotor active power feedback, under the cascade regulation superordinated both to the DFIG rotor current internal feedback and the DFIG stator power external feedback has been introduced. The DFIG vector control system fitted with an external rotor active power feedback enables the wind turbine rotation speed to be controlled by means of the rotor active power reference. By introducing a rotor active power feedback into the DFIG vector control system, a power flow control in the generator rotor circuit is rendered possible in both stationary and dynamic wind turbine operation modes. The DFIG vector control structure has proved to be particularly suited to wind turbines with pronounced wind speed time changes. The paper also discusses the wind turbine dynamic characteristics with and without a feedback rotor active power within the DFIG vector control system at varying and sudden variations in rotation speed.

**Key-Words:** Doubly-Fed Induction Generator, vector control, rotor power feedback control, simulation

## 1 Introduction

Variable speed wind turbines fitted with a DFIG connected to the electric grid are nowadays increasingly gaining in importance due to their total automatic control of both active and reactive power output. Active and reactive DFIG control system consists of two control sub-systems [1,5]: two semiconductor power converters, one on the rotor side and one on the grid side. Both converter systems employ the DFIG active and reactive power vector control. The rotor current vector is divided into two components: one controlling the magnetic flux and the other controlling the generator electromagnetic moment.

Mechanical power obtained from the wind turbine is converted into electric power by the DFIG and imparted to the grid through the generator stator and rotor. In this it is necessary to make up for the

losses in stator and rotor copper coils (iron losses, as well as the ones caused by friction and ventilation have not been considered in this paper). The wind turbine power distribution between the DFIG stator and rotor depends on the wind turbine control system active power reference [3]. The DFIG can operate in both the super-synchronous and the sub-synchronous operation modes, and the DFIG can impart power to the grid or take power from it with increased losses in the generator copper coils. The wind turbine power control system should

ensure a conversion of wind turbine mechanical power into the wind turbine electric power imparted to the grid with a minimum rotor power in both stationary and dynamic variable speed wind turbine operation modes. By introducing a rotor active power feedback control into the structure of the DFIG wind turbine active power vector control system a minimum active power in the rotor circuit and the back-to-back converter is ensured.

The supraordinated rotor active power feedback control at the same time acts as the DFIG stator active power reference in all stationary and dynamic wind turbine operation modes. The wind turbine vector control structure as presented in this paper provides a reliable conversion of the wind turbine mechanical power into the DFIG electric power with a minimum active power in the rotor circuit, as well as minimum losses in the generator coils. This configuration of the DFIG vector control is

-----  
**Hasan mansouri**, [lonely.mansouri@gmail.com](mailto:lonely.mansouri@gmail.com), Kerman Regional Electric Company, kerman, iran

**Mahdiyeh eslami**, [mahdiyeh\\_eslami@yahoo.com](mailto:mahdiyeh_eslami@yahoo.com), department of electrical engineering, kerman branch, islamic azad university, kerman, iran

**Abolfazl jabbari**, [jabbari.abolfazl@yahoo.com](mailto:jabbari.abolfazl@yahoo.com), department of electrical engineering, kerman branch, islamic azad university, kerman, iran

**Mehرداد nazari**, [nazari.mehرداد189@yahoo.com](mailto:nazari.mehرداد189@yahoo.com), department of electrical engineering, kerman branch, islamic azad university, kerman, iran

particularly suited to a wind turbine exposed to pronounced wind speed changes.

The DFIG vector control system with external rotor active power feedback enables the wind turbine speed rotation control by means of rotor active power reference control. By incorporating the rotor active power feedback into the DFIG vector control system a control of power flow in the generator in both stationary and dynamic wind turbine operation modes is made possible.

**2 DFIG Wind Turbine Control System Basic Configuration**

A typical DFIG wind turbine configuration consists of an induction wound generator with the stator coil connected to the three-phase grid and the rotor coil connected to the grid by means of a back-to-back semi conductor power converter [1,6]. A functional block diagram of an active and reactive power wind turbine control system fitted with the DFIG and a back-to back converter connected to the electric grid is shown in Fig.1.

The structure of the wind turbine active and reactive power control system has been resolved by applying a known induction machine vector control based on a double-axis theory of electric motors. The rotor-side converter vector control system makes use of the aligned to stator magnetic flux vector coordinate system, while the grid-side converter regulation system employs the grid voltage vector.

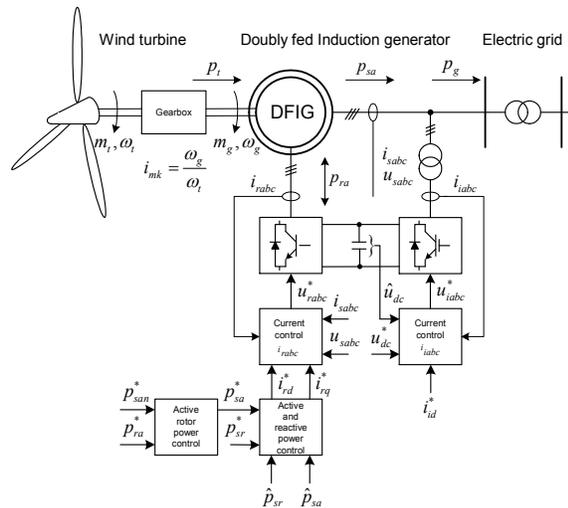


Fig.1. Wind turbine control system with DFIG

The role of the DFIG is to convert the wind turbine mechanical power  $p_t$  into the electric power  $p_g$  imparted to the grid. The rotor active power can be

imparted to the grid ( $p_{ra} > 0$ ) or taken from it by the generator ( $p_{ra} < 0$ ), or the DFIG rotor power may be equal to zero ( $p_{ra} = 0$ ). The stator active power reference  $p_{sa}^*$  determines the distribution of the wind turbine power  $p_t$  to stator  $p_{sa}$  and rotor active power  $p_{ra}$  respectively [3].

By introducing a rotor active power feedback into the DFIG vector control structure an automatic generation of the required reference is obtained  $p_{sa}^*$ , thereby ensuring a minimum rotor active power in both stationary and dynamic generator operation modes. In stationary operation modes the rotor power equals zero ( $p_{ra} = 0$ ), and the electric power imparted to the grid equals the stator power ( $p_g = p_{sa}$ ).

**3 Wind Turbine Dynamic Model**

A wind turbine mathematical model usually contains the following elements representing its basic functional components (Fig.2): the wind turbine aero-dynamic model, the wind turbine drive train model, the model of the DFIG induction generator fitted with a back-to-back converter in the rotor circuit, electric grid model and the wind turbine control system model.

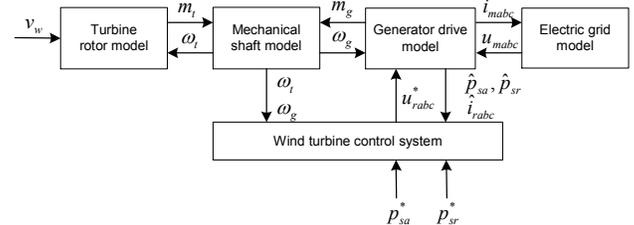


Fig.2. Block diagram of the dynamic model of a wind turbine connected to the electric grid

This paper is primarily concerned with exploring the effects of rotor power regulation within the DFIG wind turbine vector control system. Simulations have been run for the fixed electric grid and the known mean value of wind speed. The complexity of the wind turbine dynamic model has been designed in accordance with the aims of this research.

Wind turbine dynamics simulations have been run for wind step changes. The characteristic feature of the dependence of the wind turbine power upon the wind speed has been illustrated in Fig. 3 (the nominal power being 2 MW) [2].

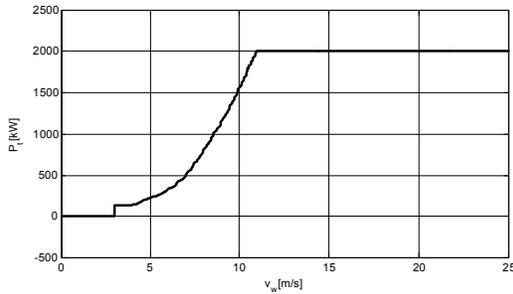


Fig. 3. Static characteristic of wind turbine mechanical power  $P_t$  as a function of mean wind speed

For a given wind speed  $v_w$  the wind turbine power  $p_t$  and the moment  $m_t = p_t / \omega_t$  are obtained, the latter representing an input value into the mathematical two-mass model drive train (Fig.2).

*Two-mass shaft system model*

In this paper a known dynamic wind turbine and generator two-mass drive train model have been chosen [2,3]. The differential equation dynamic model system coefficients are as follows:  $J_t$  – wind turbine inertia;  $J_g$  – induction generator inertia;  $D_{vt}$  – wind turbine shaft damping coefficient;  $K_{vt}$  – wind turbine shaft stiffness coefficient; and  $i_{mk}$  – gearbox transmission ratio.

Model input values are as follows:  $v_w$  – wind speed by means of which, based on the static characteristic as shown in Fig. 3, the wind turbine power is obtained;  $m_t$  – wind turbine torque, and  $m_g$  – induction generator electromagnetic moment obtained from the DFIG dynamic model.

Wind turbine dynamic model status variables, at the same time representing the model output values, are as follows:  $\mathcal{G}_t$  – wind turbine rotor angle;  $\mathcal{G}_g$  – generator rotor angle;  $\omega_t$  – wind turbine rotational speed;  $\omega_g$  – generator rotor rotational speed.

The wind turbine drive train model includes the inertia of the wind turbine, generator and gearbox connecting the two rotating shafts. The common equation of the turbine and generator shaft mechanical motion connects the drive train system dynamic model to that of the DFIG.

*Doubly-fed induction generator dynamic model*

Induction machine dynamic operation modes have been described by means of a system of voltage differential equations for the stator and rotor coils respectively. The DFIG mathematical model expressed in unit values and  $\alpha\beta$  coordinate system are as follows [3,4]:

$$\begin{aligned} \frac{d\psi_{s\alpha}}{dt} &= -\frac{1}{T_s'}\psi_{s\alpha} + \frac{k_r}{T_s'}\psi_{r\alpha} + u_{s\alpha}, \\ \frac{d\psi_{s\beta}}{dt} &= -\frac{1}{T_s'}\psi_{s\beta} + \frac{k_r}{T_s'}\psi_{r\beta} + u_{s\beta}, \\ \frac{d\psi_{r\alpha}}{dt} &= \frac{k_s}{T_r'}\psi_{s\alpha} - \frac{1}{T_r'}\psi_{r\alpha} - \omega\psi_{r\beta} + u_{r\alpha}, \\ \frac{d\psi_{r\beta}}{dt} &= \frac{k_s}{T_r'}\psi_{s\beta} + \omega\psi_{r\alpha} - \frac{1}{T_r'}\psi_{r\beta} + u_{r\beta}, \end{aligned} \tag{1}$$

Rotor and stator feed voltage vector components are:

$$\begin{aligned} u_{s\alpha} &= u_{sa}, \\ u_{s\beta} &= \frac{1}{\sqrt{3}}(u_{sb} - u_{sc}), \\ u_{r\alpha} &= u_{ra}, \\ u_{r\beta} &= \frac{1}{\sqrt{3}}(u_{rb} - u_{rc}). \end{aligned} \tag{2}$$

The stator and rotor current vector components, expressed by means of the known magnetic flux components, are as follows:

$$\begin{aligned} i_{s\alpha} &= \frac{1}{L_s'}\psi_{s\alpha} - \frac{k_s}{L_r'}\psi_{r\alpha}, \\ i_{s\beta} &= \frac{1}{L_s'}\psi_{s\beta} - \frac{k_s}{L_r'}\psi_{r\beta}, \\ i_{r\alpha} &= -\frac{k_r}{L_s'}\psi_{s\alpha} + \frac{1}{L_r'}\psi_{r\alpha}, \\ i_{r\beta} &= -\frac{k_r}{L_s'}\psi_{s\beta} + \frac{1}{L_r'}\psi_{r\beta}. \end{aligned} \tag{3}$$

The generator electromagnetic moment, at the same time representing the input value of the wind turbine two-mass model, is:

$$m_e = \psi_{s\alpha}i_{s\beta} - \psi_{s\beta}i_{s\alpha}. \tag{4}$$

The following are the parameters as occurring in the equations from (1) to (3) :

$$L'_s = \sigma L_s, L'_r = \sigma L_r, \sigma = 1 - \frac{L_m^2}{L_s L_r}, k_s = \frac{L_m}{L_s},$$

$$k_r = \frac{L_m}{L_r}, T'_s = \frac{L'_s}{R_s} \text{ and } T'_r = \frac{L'_r}{R_r}.$$

The induction generator stator active and reactive power momentary value is obtained by multiplying the stator voltage vector by conjugated-complex value of the stator current vector, as illustrated below:

$$p_{sa} = u_{s\alpha} i_{s\alpha} + u_{s\beta} i_{s\beta}, \tag{5}$$

$$p_{sr} = u_{s\beta} i_{s\alpha} - u_{s\alpha} i_{s\beta}. \tag{6}$$

The DFIG rotor active power momentary value may be calculated in a similar way:

$$p_{ra} = u_{r\alpha} i_{r\alpha} + u_{r\beta} i_{r\beta}. \tag{7}$$

The momentary value of the rotor reactive power equals zero.

The momentary values of the induction generator stator and rotor current may be obtained from the  $\alpha\beta$  coordinate system components by means of the following equations:

$$i_s = \sqrt{i_{s\alpha}^2 + i_{s\beta}^2}, \tag{8}$$

$$i_r = \sqrt{i_{r\alpha}^2 + i_{r\beta}^2}.$$

Losses in the generator coils stator and rotor DFIG are:

$$p_{Cu} = R_s i_s^2 + R_r i_r^2. \tag{9}$$

Input values of voltage equation system (1) represent the components of the stator feed voltage vector  $\bar{u}_{s\alpha\beta}$  and rotor feed vector  $\bar{u}_{r\alpha\beta}$ , whereas the status variables, being at the same time the system output values, act as stator and rotor flux vectors. The output values are represented by the generator electromagnetic flux, stator and rotor power, as well as stator and rotor current vector components.

#### 4 Wind Turbine Active and Reactive Power Control System

The vector regulation of the wind turbine active and reactive power is ensured by the regulation of the DFIG active and reactive power. The DFIG active and reactive power vector control system (Fig.1) employs the following coordinate systems:

- induction generator is modelled in the  $\alpha\beta$  coordinate system which, in relation to the abc coordinate system, stands still;
- the rotor-side converter is modelled in the dq coordinate system linked to the stator magnetic flux vector.

The simulations as run in this paper refer to the DC-link fixed voltage source, therefore the mathematical model of the grid-side converter has not been presented.

The structural block diagram of the DFIG active and reactive power vector control system fitted with the rotor power feedback control has been illustrated in Fig. 4.

By introducing a rotor active power feedback control into the structure of wind turbine active power DFIG vector control, the power in the rotor circuit is considerably reduced, and also the losses in the generator coils in both stationary and dynamic operation modes at different wind speeds. By choosing the zero reference of the rotor active power regulation ( $p_{ra}^* = 0$ ), this vector control system enables the turbine active power to be converted into the DFIG stator active power with a minimum active power in the back-to-back converter rotor circuit.

#### 5 Simulation Results

Simulations for wind step changes  $v_w = 9[m/s]$  at the moment  $t = 6[s]$  and  $v_w = 14[m/s]$  at the moment  $t = 50[s]$  have been run within the research as presented in this paper (Fig.5). Figures 6., 7. and 8. illustrate time responses of the generator rotor rotational speed  $\omega_g$ , stator active power  $p_{sa}$ , rotor active power  $p_{ra}$ , losses in the stator and rotor coils  $p_{Cu}$ , stator



Time responses simulations have been run with respect to the stator active power reference  $p_{sa}^* = 1.0[pu]$ , stator reactive power reference  $p_{sr}^* = 0.0[pu]$  and the rotor active power reference  $p_{ra}^* = 0.0[pu]$ . The calculations have been done by means of the parameters pertaining to the wind turbine and induction generator of 2MW power as quoted in the references [2,3].

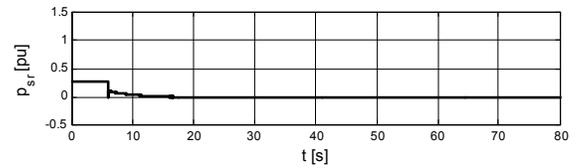
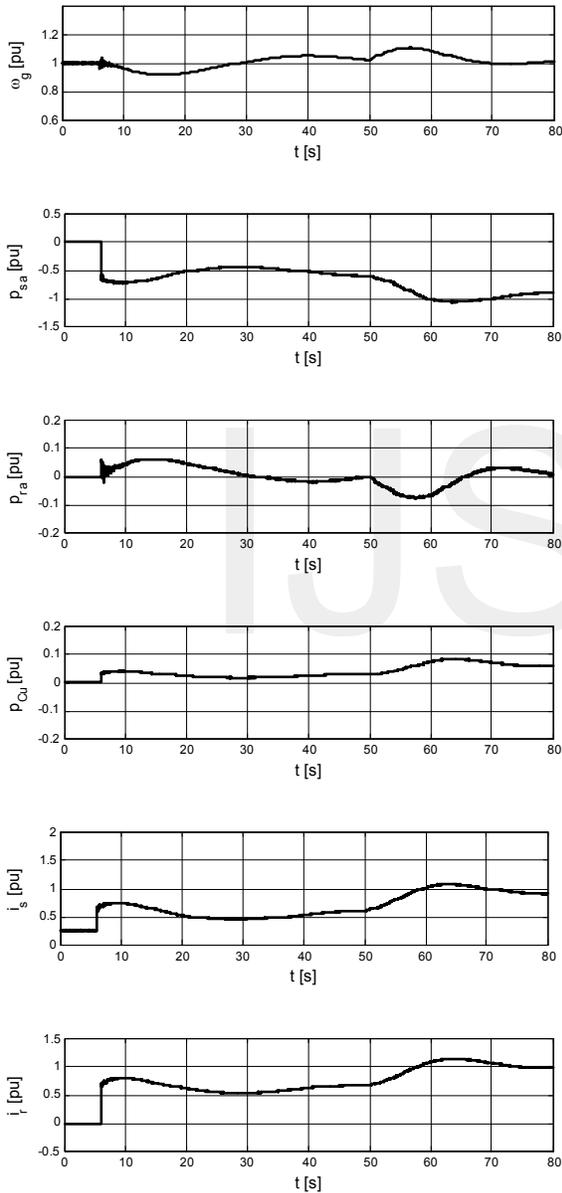
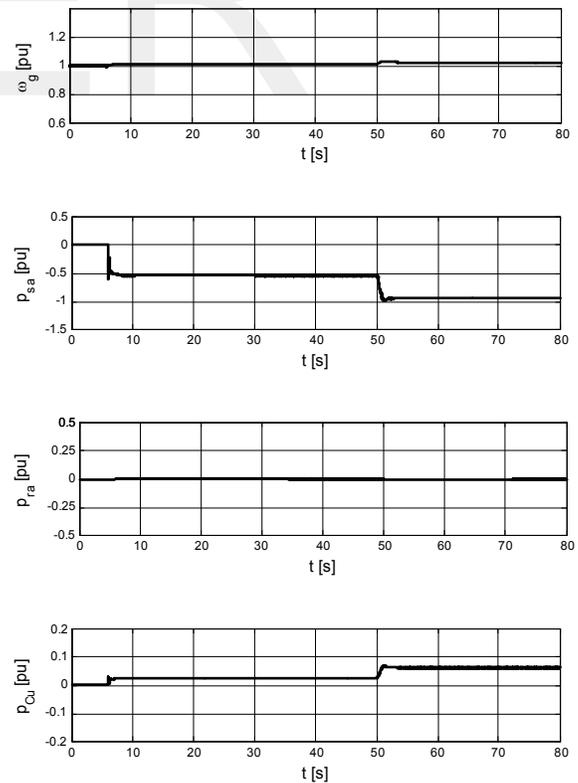


Fig.7. Time responses with the rotor active power regulation;  $K_{pr} = 2.0$ ,  $K_{ir} = 0.002$ ,  $p_{ra}^* = 0.0[pu]$ .

Simulation of the vector control time responses without the rotor active power regulation has been shown in Fig. 6, whereas Figures 7. and 8. illustrate the time responses with the rotor active power regulation. The rotor active power regulation parameters as shown in Fig.7. are equal to the stator power regulation in the DFIG cascade regulation mode ( $K_{pr} = 2, K_{ir} = 0.002$ ). All the physical values presented in this figure display a pronounced transitional phenomenon.

By choosing the rotor active power regulation  $K_{pr} = 100$  and  $K_{ir} = 0.05$  time responses with



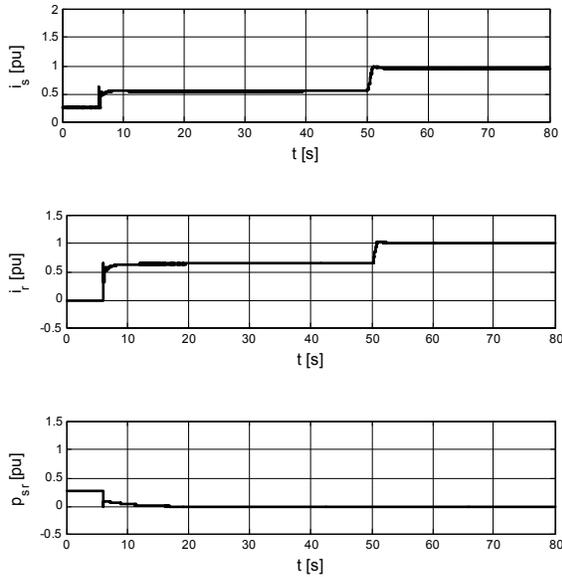


Fig.8. Time responses with the rotor active power regulation;  $K_{pr} = 100.0$ ,  $K_{ir} = 0.05$ ,  $p_{ra}^* = 0.0[pu]$ .

considerably better indicators of regulation quality are obtained, as shown in Fig.8. Transitional phenomena of electric values are considerably shorter, thereby rendering the entire DFIG wind turbine system more adjustable to sudden wind step changes. The DFIG vector control system fitted with rotor active power regulation follows the power obtained from the wind turbine regardless of the given stator active power reference.

Figures 7. and 8. illustrate time responses of rotation speed and active power, currents and losses in both stator and rotor when the rotor active power reference equals zero ( $p_{ra}^* = 0.0[pu]$ ). By this reference a synchronous operation mode of the asynchronous generator is ensured.


Then the rotor active power in the wind turbine stationary operation modes also equals zero. By means of connecting the rotor active power external feedback with the rotor active power reference equalling zero ( $p_{ra}^* = 0.0[pu]$ ), the desired dynamic characteristics of the DFIG wind turbine system can be realised, which applies to all wind speed changes providing the wind turbine power above the nominal ( $p_i > 2MW$ ).

It is known that an optimum wind turbine operation requires the wind turbine rotation speed to be reduced at lower wind speeds, as well as all wind speed changes accounting for wind power turbine below the nominal value ( $p_i < 2[MW]$ ).

The DFIG vector control system fitted with active rotor power external feedback enables the wind turbine speed rotation to be controlled by means of controlling the reference  $p_{ra}^*$ .

Stationary characteristics of rotation speed  $\omega_g$ , active power imparted to the grid  $p_{ga}$ , losses in copper  $p_{Cu}$ , respective stator  $i_s$  and rotor currents  $i_r$ , as well as stator and rotor active powers  $p_{sa}$  and  $p_{ra}$  respectively, depending upon the rotor active power reference  $p_{ra}^*$  at wind speed  $v_w = 6[m/s]$  have been shown in figure 9.

By analysing the results as illustrated in Fig. 9, it is evident that by varying the rotor active power reference, the generator rotation speed can be significantly controlled. The higher the rotation speed changes, the lower the rotor active power reference, i.e. they are inversely proportional. The losses in the coil increase with the increase of reference  $p_{ra}^*$  commensurate with the current increase in both stator and rotor (equation 9.). The difference between the stator and rotor power taken from the grid by the DFIG is practically constant for all rotor active power references. The active power  $p_{ga}$  imparted to the grid is being constantly reduced by the rotor active power reference increase due to the increase of losses  $p_{Cu}$  in the DFIG stator and rotor coils.

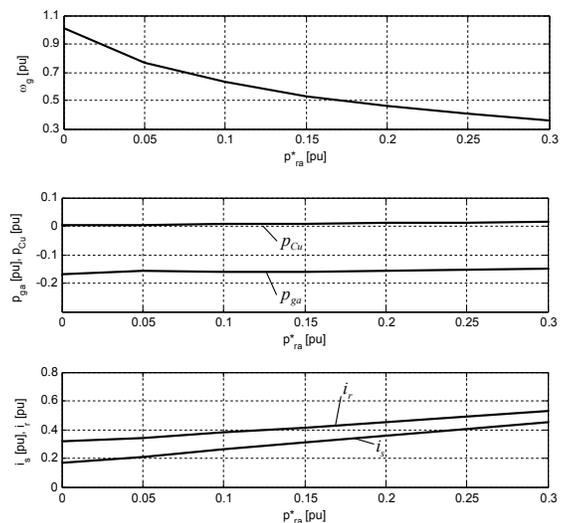

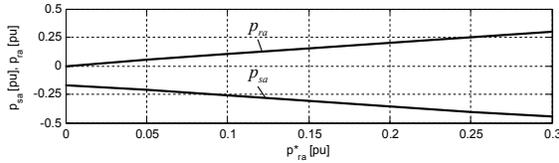


Fig. 9. DFIG stationary characteristics depending upon the rotor active power reference.

Fig. 10. shows the rotation speed responses  $\omega_g$ , respective stator  $p_{sa}$  and rotor active powers  $p_{ra}$ , as well as stator  $i_s$  and rotor currents  $i_r$ , respectively at sudden wind speed changes from  $v_{w1} = 0.0[m/s]$  to  $v_{w2} = 6[m/s]$ . The dynamic characteristics of the response of the DFIG fitted with a rotor active power feedback to wind speed changes have been found to be stable. The response speed of generator rotation speed depends upon the inertia moments of both the wind power turbine and the DFIG.

### 6 Conclusion

It is necessary to conduct a detailed investigation into the interdependence of rotor active power control parameters and rotor active power reference. By selecting the correct parameters of rotor active power control the time responses with a considerably shorter transition phenomenon are obtained, while the DFIG fitted wind turbine vector control system is rendered more adaptable to sudden wind changes.


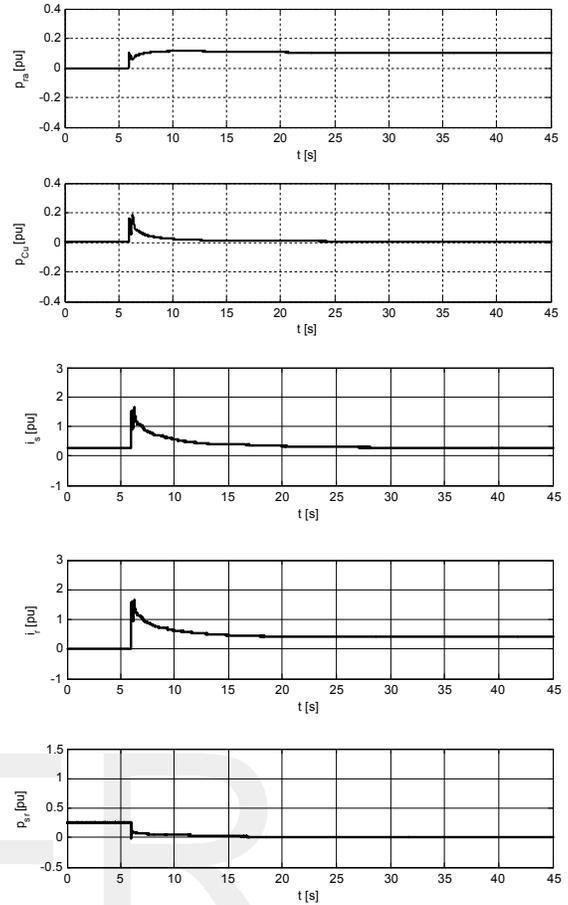


Fig. 10. Response characteristic at sudden wind speed changes;  $v_{w1} = 0.0[m/s]$ ,  $v_{w2} = 6.0[m/s]$ ,  $p_{ra}^* = 0.1[pu]$ ,  $K_{pr} = 30.0$ ,  $K_{ir} = 0.015$

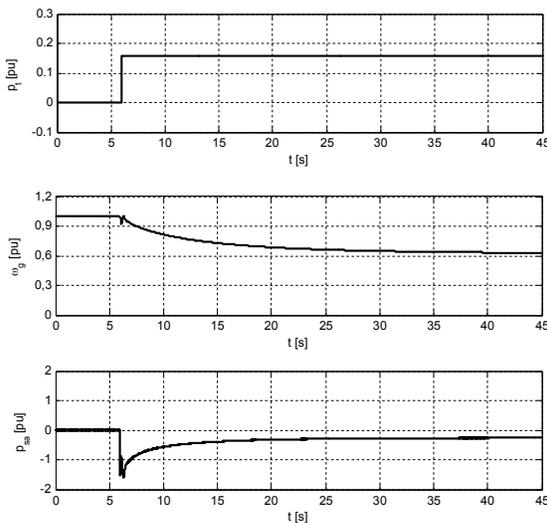

A new configuration of wind turbine active power vector controlled system has been presented and discussed in this paper. A rotor active power feedback control has been incorporated into the DFIG wind turbine vector control system, thereby ensuring a minimum power in the rotor circuit for both the stationary and dynamic wind turbine operation modes. The DFIG vector control system fitted with rotor power regulation follows the wind turbine mechanical power regardless of the given stator active power reference and variable wind speed. This configuration of DFIG vector control has proved to be particularly suitable while operating in conditions of wind step changes. The rotor active power feedback control provides an option of considerably reduced power of back-to back converter in the rotor circuit.

As has been demonstrated in this paper, the choice of rotor active power reference depends upon

the wind speed. For a wind speeds providing the wind turbine power above the nominal value the rotor active power reference equals zero, whereas the lower wind speeds are controlled by the DFIG rotation speed by means of varying the rotor active power reference.

Results of simulation of DFIG vector control system with and without rotor active power feedback control have been compared, clearly indicating that, by choosing the rotor active power regulation parameters, time responses with a considerably shorter transitional phenomenon are obtained. Furthermore, the DFIG wind turbine power vector control system has proved to be more adjustable to modes of operation involving wind step changes.

#### References:

- [1] Anca H. D., Iov F., Sorenson P., Blaabjerg F. : Overall control strategy of variable speed doubly – fed induction generator wind turbine, Nordic Wind Power Conference, Chalmers University of Technology, March, 2004.
- [2] Smajo J., Smajo M., Vukadinovic D.: Impact of Reference Value of Wind Turbine Active Power to the Distribution of Doubly-Fed Induction Generator Power, WSEAS Transaction on System 5., January 2006.
- [3] Krause P.C.: Analysis of Electric Machinery, New York, McGraw-Hill, 1994.
- [4] Poitiers F., Machmoum M., Le Doeuff R., Zaim M.E.: Control of a doubly-fed induction generator for wind energy conversion systems, [http://www.itee.uq.edu.au/~aupec/aupec01/026\\_%20POITIERS%20\\_AUPEC01%20paper%20revised.pdf](http://www.itee.uq.edu.au/~aupec/aupec01/026_%20POITIERS%20_AUPEC01%20paper%20revised.pdf)
- [5] Tou S., Zhe C., Blaabjerg F.: Transient Stability of DFIG Wind Turbines at an External Short-circuit Fault, WIND ENERGY, August, 2005.
- [6] Mahdi Mozaffari Legha, "Determination of exhaustion and junction of in distribution network and its loss maximum, due to geographical condition", MS.c Thesis; Islamic Azad University, Saveh Branch, Markazi Province, Iran; pp. 1-300, Aug 2011.
- [7] Mahdi Mozaffari Legha, Rouhollah Abdollahzadeh, Ardalan Zargar, Mostafa Shadfar. "Effective method for optimal allocation of distributed generation units in radial electric power systems by genetic algorithm and imperialist competitive algorithm", International Journal on Technical and Physical Problems of Engineering (IJTPE), Issue 15, Vol. 5, No. 2, pp. 70-74, June 2013.
- [8] Mahdi Mozaffari Legha, Moein khosravi, Mohammad Hossein Armand, Mahdiyeh Azh., "Optimization of Location and Capacity DGs Using HPSO Approach Case Study on the Electrical Distribution Network of north Kerman Province", Middle-East Journal of Scientific Research, pp. 461-465, 2013.
- [9] Akhmatov V. : Analysis od dinamic behavior of electric power system with large amount of wind power, PhD Thesis, Electric Power Engineering, Ørsted-DTU, Technical University of Denmark, Kgs. Lyngby, Denmark, April, 2003.
- [10] Mahdi Mozaffari Legha, "Optimal Conductor Selection of Radial Distribution Networks Using GA Method" CIRED Regional – Iran, Tehran, 13-14 Jan 2013; Paper No: 12-F-500-0320.
- [11] H.K.. Lauw, C.H. Weigand, and D.A. Marckx, "Variable-speed wind system design: Final Report," U.S. Dept. of Energy, Washington, DC, Rep. DOE/BP/99893-TI, 1993.
- [12] Mahdi Mozaffari Legha and et al, "A new hybrid particle swarm optimization approach for sizing and placement enhancement of distributed generation" IEEE Conference, 2155-5516; Pages 1277 - 1281.
- [13] Web site Electrical Power Engineering Specialists, REPORTs, 2014. Available at: <<http://www.drmozaifarilegha.ir>> [accessed 01.01.2014]
- [14] T. Jahns and R.W.DeDoncker, "Control of generators," in The Control Handbook, W. Levins, Ed. Boca Raton, FL: CRC, 1996.
- [15] H. Späth, Steuerverfahren für Drehstrommaschinen: Theoretische Grundlagen. Berlin, Germany: Springer-Verlag, 1983.
- [16] H. Stemmler and A. Omlin, "Converter controlled fixed-frequency variable-speed motor/generator," presented at the IPEC '95, Japan.
- [17] Mahdi Mozaffari Legha, Houman Gadari, "Technical and Economical Evaluation of Solar Plant for Electricity Supply Anar City Residential Customers", Middle-East Journal of Scientific Research, pp. 455-460, 2013.
- [18] Mahdi Mozaffari Legha, Farzaneh Ostovar, "Analysis and Reconductoring of Overhead Conductors with Considering aging for Radial Distribution Systems Using Imperialist competitive Algorithm", International Journal of Pure and Applied Sciences and Technology, Vol. 20, No. 1, January 2014, pp. 1-8.
- [19] D. Arsudis, "Doppeltgespeister Drehstromgenerator mit Spannungszwischenkreis-Umrichter im Rotorkreis für Windkraftanlagen," Ph.D. dissertation, Fakultät für Maschinenbau und Elektrotechnik Technische Universität Braunschweig, Germany, 1989.
- [20] Mahdi Mozaffari Legha, Mohammad Mohammadi; Aging Analysis and Reconductoring of Overhead Conductors for Radial Distribution Systems Using Genetic Algorithm; Journal of Electrical Engineering & Technology (JEET); pp. 1-8, 2014.